

PUMP CONTROL OWNER'S OPERATION MANUAL

Dual Pump Controller Installation
and Operating Instructions

MODEL: RAM-30005-TC

Deluxe Hot Water Circulator c/w Time Clock




WARNING: All electrical connections must be carried out by a suitably qualified and registered electrician

SAFETY

- Prior to Installation, ensure power supply is isolated.
- Power supply must be Circuit Breaker Protected. (Qualified Electrician to determine appropriate amp rating.)
- Electrical connection to the panel must be carried out in accordance with 'Connection Instructions', see page 3.
- Addition or modifications to the control panel are not permitted and will void warranty.
- The controller is not intended for use by children or infirm persons without supervision.
- Repairs to the Controller must only be carried out by a suitably qualified Electrician

CONNECTION

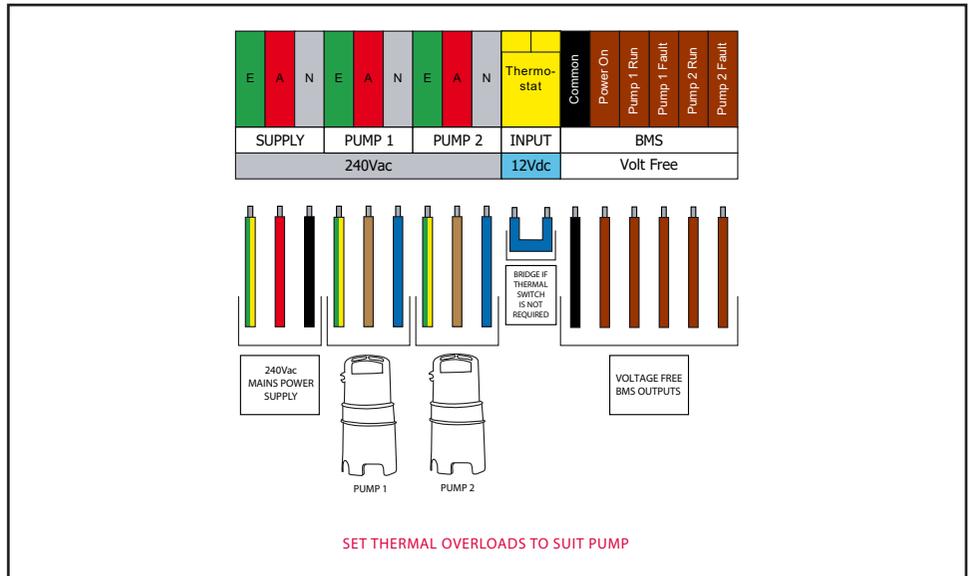

Note: Controller must be earthed and all electrical connections must be carried out by a suitably qualified Electrician.

Maximum Run and Alternation Mode

With **DIP Switch 3** set to "Off" the unit will alternate as usual each time a pump start condition occurs. Additionally, the controller will automatically alternate pump duty if a pump has been running continuously for 30 minutes (maximum run timer)

Setting this DIP Switch to "On" will cause the controller to operate in "Circulation Mode" where duty will only alternate once the pump has run for 6 hours of accumulated time.

Manual Mode Timeout

With **DIP Switch 5** set to "On" the pump will only remain in Manual Mode for 5 minutes, after which time, it automatically reverts to Auto.

Audible and Visual Alarm Test

By pressing the **Mute/Reset** button on the Keypad continuously for a period of 5 seconds, the Strobe, Siren and indicator Lights will be powered up for inspection.

Fault Reset

To reset all faults on the controller, press and hold the **Mute/Reset** button on the Keypad continuously for a period of 3 seconds until an acknowledgment beep is heard.

Pump Fault

A Pump Fault is indicated for two types of faults. A Thermal Overload will be indicated by way of a steady Fault Indicator Light. Both types of faults can be reset by way of the Fault Reset button.


Auto Silencing Alarm Feature

The audible Alarm is programmed to sound for 5 minutes continuously, unless muted and will thereafter automatically

SETTING UP TIME CLOCK

1. To start switch, press Reset key
2. To adjust the present time, please press  key, then press D+, H+, M+ to adjust the Days, Hours and Minutes.
3. Programming steps as follows:

Step	Key	Programming
1	Press P	Setting 1 ON time (display 1 on)
2	Press H+/M+	Setting hours and minutes
3	Press D+	Select same everyday, different day, MO-FR, MO-SA, SA-SU, MO WE FR, TU THU SA, MO-WE, TH-SA. (if same everyday, no need to press this key)
4	Press P	Setting 1 OFF time (display 1 off)
5	Press H+/M+	Setting hours and minutes of the turn off time
6	Press D+	If you want the same setting every day, there is no need to press this key
7	Repeat steps 2~6	Set 2-17 ON/OFF times
8	Press 	End

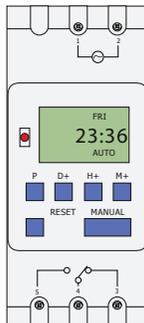

CIRCUIT DIAGRAM

